

ANNUAL WATER
QUALITY
REPORT

WATER TESTING PERFORMED IN 2016



Presented By
City of Havelock

We've Come a Long Way


Once again we are proud to present our annual water quality report covering the period between January 1 and December 31, 2016. In a matter of only a few decades, drinking water has become exponentially safer and more reliable than at any other point in human history. Our exceptional staff continues to work hard every day—at any hour—to deliver the highest quality drinking water without interruption. Although the challenges ahead are many, we feel that by relentlessly investing in customer outreach and education, new treatment technologies, system upgrades, and training, the payoff will be reliable, high-quality tap water delivered to you and your family.

Community Participation

You are invited to participate in our public forum and voice your concerns about your drinking water. The Havelock Board of Commissioners meet the second and fourth Mondays of each month, beginning at 7 p.m. at City Hall, 1 Governmental Avenue, Havelock, NC 28532. Or, you may visit the Public Services Department section on our website at www.havelocknc.us.

Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants may be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The U.S. EPA/CDC (Centers for Disease Control and Prevention) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at (800) 426-4791 or at <http://water.epa.gov/drink/hotline>.

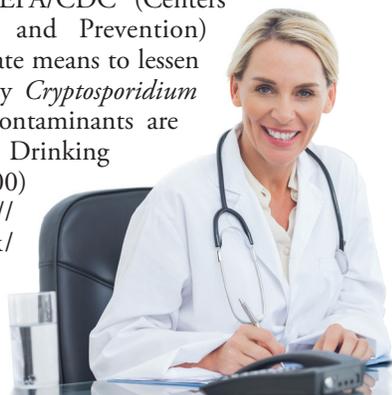

Where Does My Water Come From?

Havelock's water supply comes from the Castle Haynes Aquifer, a ground water source underlying the eastern half of the coastal plain. It is the major source for much of coastal North Carolina and the most productive aquifer in the state. Water in the Castle Haynes ranges from hard to very hard due to its limestone content, with some areas having high concentrations of iron and chloride. In 2016, the City of Havelock had four wells reaching into this aquifer at varying depths, all greater than 200 feet. The city has a permit to withdraw up to 2.8 million gallons per day from the aquifer.

Substances That Could Be in Water

To ensure that tap water is safe to drink, the U.S. EPA prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals, in some cases, radioactive material, and substances resulting from the presence of animals or from human activity. Substances that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife;

Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban storm-water runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and may also come from gas stations, urban storm-water runoff, and septic systems;

Radioactive Contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

For more information about contaminants and potential health effects, call the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

How Is My Water Treated and Purified?

Raw water is pumped from the wells into the city's water treatment plant. The raw water is first aerated and then dosed with sodium permanganate to oxidize and assist in the removal of iron. Water is then pumped through pressure filters containing greensand media to further remove iron and manganese. After filtration, a portion of the flow is processed through zeolite softening units and then combined with unsoftened, filtered water at a ratio that produces an acceptable hardness. Next, the water is disinfected with chloramines to be kept free of bacteria as it passes through the distribution system. Finished water is pumped into the city's elevated storage tanks (water towers) to provide adequate supply and pressure. The water then travels to your home or business through a series of pipes and valves.



Source Water Assessment Program

The North Carolina Department of Environment and Natural Resources (DENR), Public Water Supply Section (PWS), Source Water Assessment Program (SWAP) conducted assessments for all drinking water sources across North Carolina. The purpose of the assessments was to determine the susceptibility of each drinking water source (well or surface water intake) to potential contaminant sources (PCSs). The results of the assessments are available in SWAP reports that include maps, background information, and a susceptibility rating of Higher, Moderate, or Lower.

The relative susceptibility rating of each source for the City of Havelock wells was determined by combining the contaminant rating (number and location of PCSs within the assessment area) and inherent vulnerability rating (i.e., characteristics or existing conditions of the well and its delineated assessment area). The assessment reported a susceptibility rating of Higher for our water source. This susceptibility rating does not imply poor water quality, but rather the system's potential to become contaminated by PCSs in the assessment area.

The complete SWAP report for the City of Havelock may be viewed on the Internet at www.ncwater.org/pws/swap. To obtain a printed copy of this report, please mail a written request to Source Water Assessment Program - Report Request, 1634 Mail Service Center, Raleigh NC 27699-1634, or email a request to swap@ncmail.net. Please indicate your system name and PWS ID (NC0425015), as well as your name, mailing address, and phone number. If you have any questions about the SWAP report, please contact the Source Water Assessment staff by calling (919) 715-2633.

Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/lead.

What's a Cross-connection?

Cross-connections that contaminate drinking water distribution lines are a major concern. A cross-connection is formed at any point where a drinking water line connects to equipment (boilers), systems containing chemicals (air conditioning systems, fire sprinkler systems, irrigation systems), or water sources of questionable quality. Cross-connection contamination can occur when the pressure in the equipment or system is greater than the pressure inside the drinking water line (back-pressure). Contamination can also occur when the pressure in the drinking water line drops due to fairly routine occurrences (main breaks, heavy water demand), causing contaminants to be sucked out from the equipment and into the drinking water line (back-siphonage).

Outside water taps and garden hoses tend to be the most common sources of cross-connection contamination at home. The garden hose creates a hazard when submerged in a swimming pool or when attached to a chemical sprayer for weed killing. Garden hoses that are left lying on the ground may be contaminated by fertilizers, cesspools, or garden chemicals. Improperly installed valves in your toilet could also be a source of cross-connection contamination.

Community water supplies are continuously jeopardized by cross-connections unless appropriate valves, known as backflow prevention devices, are installed and maintained. We have surveyed industrial, commercial, and institutional facilities in the service area to make sure that potential cross-connections are identified and eliminated or protected by a backflow preventer. We also inspect and test backflow preventers to make sure that they provide maximum protection.

For more information on backflow prevention, contact the Safe Drinking Water Hotline at (800) 426-4791.

QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please call David Hemenway, Water Plant Supervisor, at (252) 444-6420, or email at dhemenway@havelocknc.us.

Benefits of Chlorination

Disinfection, a chemical process used to control disease-causing microorganisms by killing or inactivating them, is unquestionably the most important step in drinking water treatment. By far, the most common method of disinfection in North America is chlorination.



Before communities began routinely treating drinking water with chlorine (starting with Chicago and Jersey City in 1908), cholera, typhoid fever, dysentery, and hepatitis A killed thousands of U.S. residents annually. Drinking water chlorination and filtration have helped to virtually eliminate these diseases in the U.S. Significant strides in public health are directly linked to the adoption of drinking water chlorination. In fact, the filtration of drinking water plus the use of chlorine is probably the most significant public health advancement in human history.

How Chlorination Works:

Potent Germicide Reduction in the level of many disease-causing microorganisms in drinking water to almost immeasurable levels.

Taste and Odor Reduction of many disagreeable tastes and odors like foul-smelling algae secretions, sulfides, and odors from decaying vegetation.

Biological Growth Elimination of slime bacteria, molds, and algae that commonly grow in water supply reservoirs, on the walls of water mains, and in storage tanks.

Chemical Removal of hydrogen sulfide (which has a rotten egg odor), ammonia, and other nitrogenous compounds that have unpleasant tastes and hinder disinfection. It also helps to remove iron and manganese from raw water.

Water Main Flushing

Distribution mains (pipes) convey water to homes, businesses, and hydrants in your neighborhood. The water entering distribution mains is of very high quality; however, water quality can deteriorate in areas of the distribution mains over time. Water main flushing is the process of cleaning the interior of water distribution mains by sending a rapid flow of water through the mains.

Flushing maintains water quality in several ways. For example, flushing removes sediments like iron and manganese. Although iron and manganese do not pose health concerns, they can affect the taste, clarity, and color of the water. Additionally, sediments can shield microorganisms from the disinfecting power of chlorine, contributing to the growth of microorganisms within distribution mains. Flushing helps remove stale water and ensures the presence of fresh water with sufficient dissolved oxygen, disinfectant levels, and an acceptable taste and smell.

During flushing operations in your neighborhood, some short-term deterioration of water quality, though uncommon, is possible. You should avoid tap water for household uses at that time. If you do use the tap, allow your cold water to run for a few minutes at full velocity before use, and avoid using hot water to prevent sediment accumulation in your hot water tank.

Please contact us if you have any questions or if you would like more information on our water main flushing schedule.

Failure in Flint

The national news coverage of water conditions in Flint, Michigan, has created a great deal of confusion and consternation. The water there has been described as being corrosive; images of corroded batteries and warning labels on bottles of acids come to mind. But is corrosive water necessarily bad?

Corrosive water can be defined as a condition of water quality that will dissolve metals (iron, lead, copper, etc.) from metallic plumbing at an excessive rate. There are a few contributing factors but, generally speaking, corrosive water has a pH of less than 7; the lower the pH, the more acidic, or corrosive, the water becomes. (By this definition, many natural waterways throughout the country can be described as corrosive.) While all plumbing will be somewhat affected over time by the water it carries, corrosive water will damage plumbing much more rapidly than water with low corrosivity.

By itself, corrosive water is not a health concern; your morning glass of orange juice is considerably more corrosive than the typical lake or river. What is of concern is that exposure in drinking water to elevated levels of the dissolved metals increases adverse health risks. And therein lies the problem.

Public water systems are required to maintain their water at optimal conditions to prevent it from reaching corrosive levels. Rest assured that we routinely monitor our water to make sure that what happened in Flint never happens here. For more information on how corrosivity impacts water quality, download this informative pamphlet: <http://goo.gl/KpTmXv>.



Test Results

Our water is monitored for many different kinds of contaminants on a very strict sampling schedule. The information below represents only those substances that were detected; our goal is to keep all detects below their respective maximum allowed levels. The State recommends monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year in which the sample was taken.

We participated in the 3rd stage of the EPA's Unregulated Contaminant Monitoring Rule (UCMR3) program by performing additional tests on our drinking water. UCMR3 benefits the environment and public health by providing the EPA with data on the occurrence of contaminants suspected to be in drinking water, in order to determine if EPA needs to introduce new regulatory standards to improve drinking water quality. Contact us for more information on this program.

REGULATED SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	MCL [MRDL]	MCLG [MRDLG]	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Chloramines (ppm)	2016	[4]	[4]	1.85	0.16–3.54	No	Water additive used to control microbes
Chlorine (ppm)	2016	[4]	[4]	1.36	0.28–2.90	No	Water additive used to control microbes
Fluoride ¹ (ppm)	2013	4	4	0.23	0.23–0.23	No	Erosion of natural deposits; Discharge from fertilizer and aluminum factories
Haloacetic Acids [HAA] (ppb)	2016	60	NA	32	27–32	No	By-product of drinking water disinfection
TTHMs [Total Trihalomethanes] (ppb)	2016	80	NA	43	40–43	No	By-product of drinking water disinfection

SECONDARY SUBSTANCES

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	SMCL	MCLG	AMOUNT DETECTED	RANGE LOW-HIGH	VIOLATION	TYPICAL SOURCE
Chloride (ppm)	2016	250	NA	10	9–10	No	Runoff/leaching from natural deposits
Copper (ppm)	2016	1.0	NA	0.840	0–1.034	No	Corrosion of household plumbing systems; Erosion of natural deposits
pH (Units)	2013	6.5–8.5	NA	7.40	7.40–7.40	No	Naturally occurring

UNREGULATED SUBSTANCES²

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AMOUNT DETECTED	RANGE LOW-HIGH	TYPICAL SOURCE
Sodium (ppm)	2013	109.200	109.200–109.200	Mineral naturally occurring in soils

OTHER UNREGULATED SUBSTANCES²

SUBSTANCE (UNIT OF MEASURE)	YEAR SAMPLED	AMOUNT DETECTED	RANGE LOW-HIGH
Chlorate (ppb)	2014	581	305–581
Chromium [Total] (ppb)	2014	0.37	0.35–0.37
Chromium-6 (ppb)	2014	0.09	0.062–0.09
Strontium (ppb)	2014	129	119–129

¹Naturally occurring, not added to the water.

²Unregulated contaminants are those for which U.S. EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to assist U.S. EPA in determining the occurrence of unregulated contaminants in drinking water and whether future regulations are warranted.

Definitions

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

LRAA (Locational Running Annual Average): The average of sample analytical results for samples taken at a particular monitoring location during the previous four calendar quarters under the Stage 2 Disinfectants and Disinfection Byproducts Rule.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

SMCL (Secondary Maximum Contaminant Level): SMCLs are established to regulate the aesthetics of drinking water like appearance, taste and odor.